


Vsak prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen. This document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.

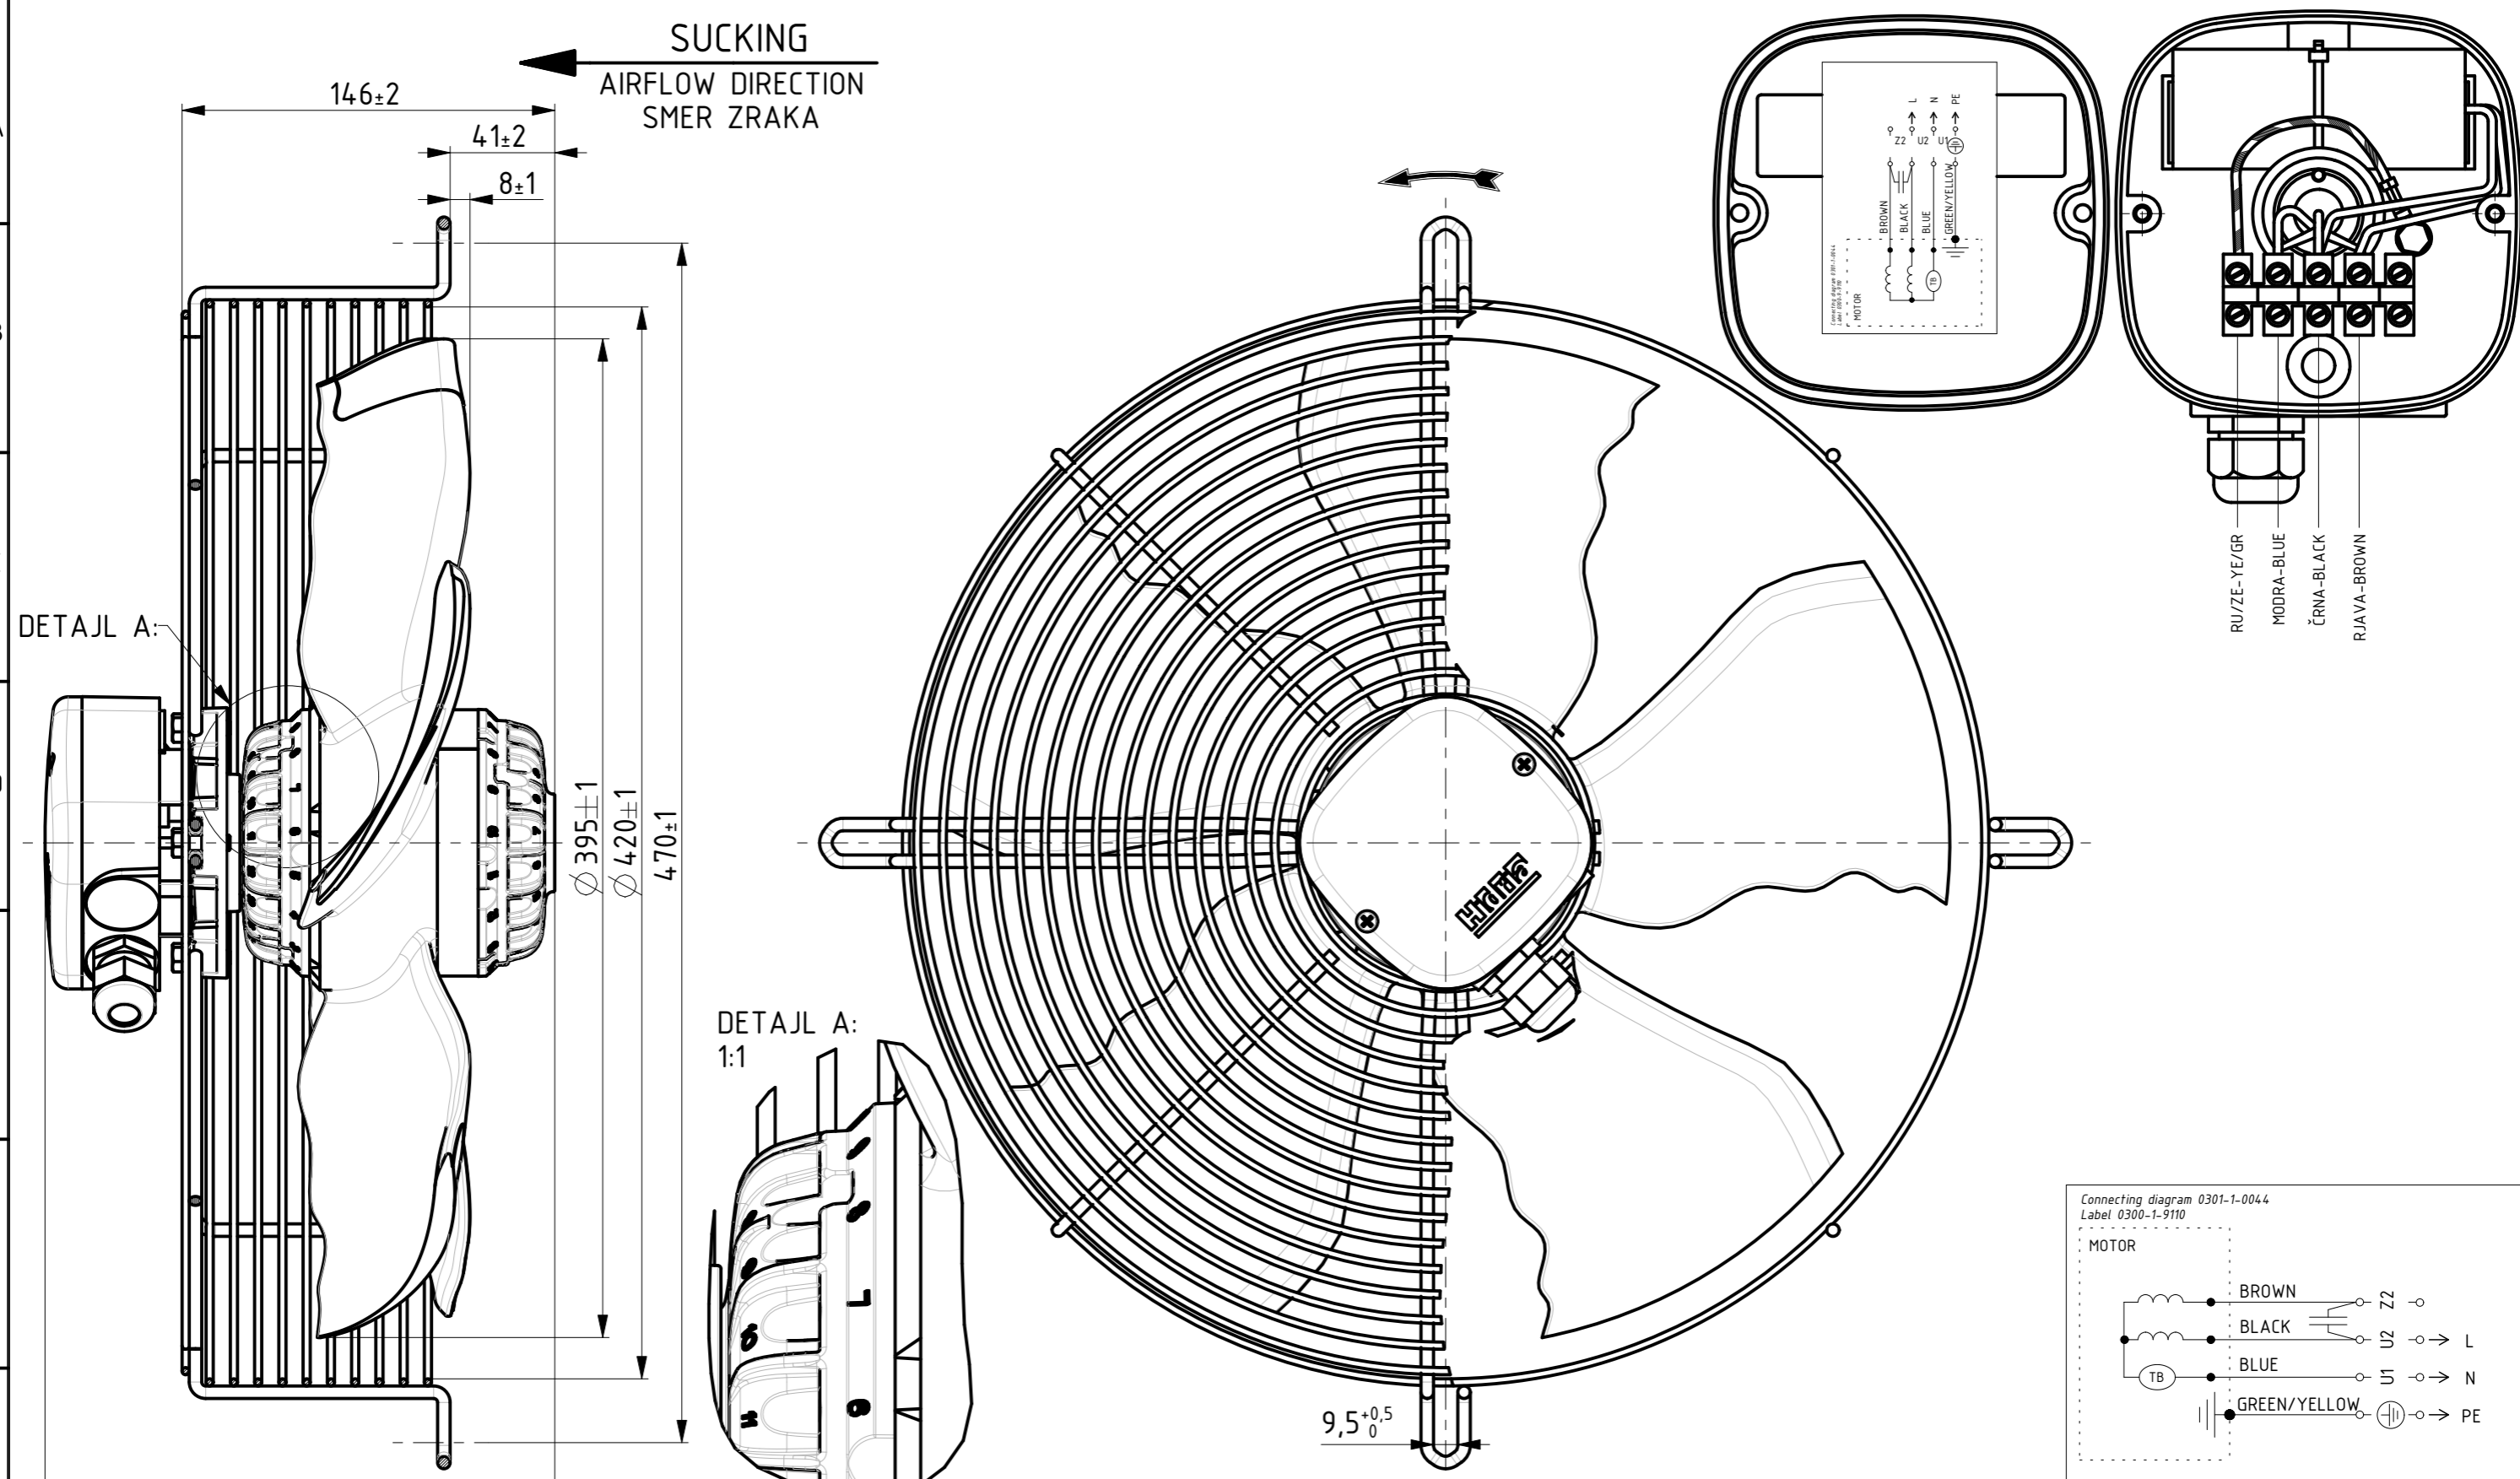

**Opombe:**  
 - navodilo za kontrolo ventilatorja 0301-1-4642  
 - checking instruction 0301-1-4642

**Hidria** MADE IN SLOVENIA **CE** DATE

R11R-40LPS-4M-5150 0311-4-0313

1~230V 50/60Hz 190/260W 0,85/1,10A 1310/1450RPM  
 MAX.AMB.70/55° C IP54 INS.CL.155 C=6,3pF/450V  
 TH.PROT. ROT.

ErP: Effes=30,9% (A,static) N=41,5

<b>Hidria</b>		NETOLERIRANE MERE UNTOLERANCED DIM.	ISO 2768-m	MERILLO/FORMAT 2:5 / A3	
Izdano		POVRŠINSKA OBD. SURFACE TEXTURE		MATERIAL	
		RISAL	DATUM 26-Jan-2009	PODPIS Uroš K.	NAZIV: TITLE: <b>VENTILATOR</b>
		PROJEKTIRAL	26-Jan-2009	Uroš T.	<b>R11R-40LPS-4M-5150</b>
		POTRDL ROTMATIKA MOTORS			KODA: CODE: 0311-4-0313
		POTRDL SPE LIVARSTVO			VERZIJA: REV: AB
		POTRDL SPE LAMELE			LIST: SHEET: 1
		POTRDL ROTMATIKA FANS			OD: OF: 1
		POTRDL			
3	271/12	05-Dec-2012	Uroš K.		
2	184/10	16-Avg-2010	Uroš K.		
1	027/09	26-Jan-2009	Uroš K.		
ST.	ST.SPR.	DATUM	PODPIS		